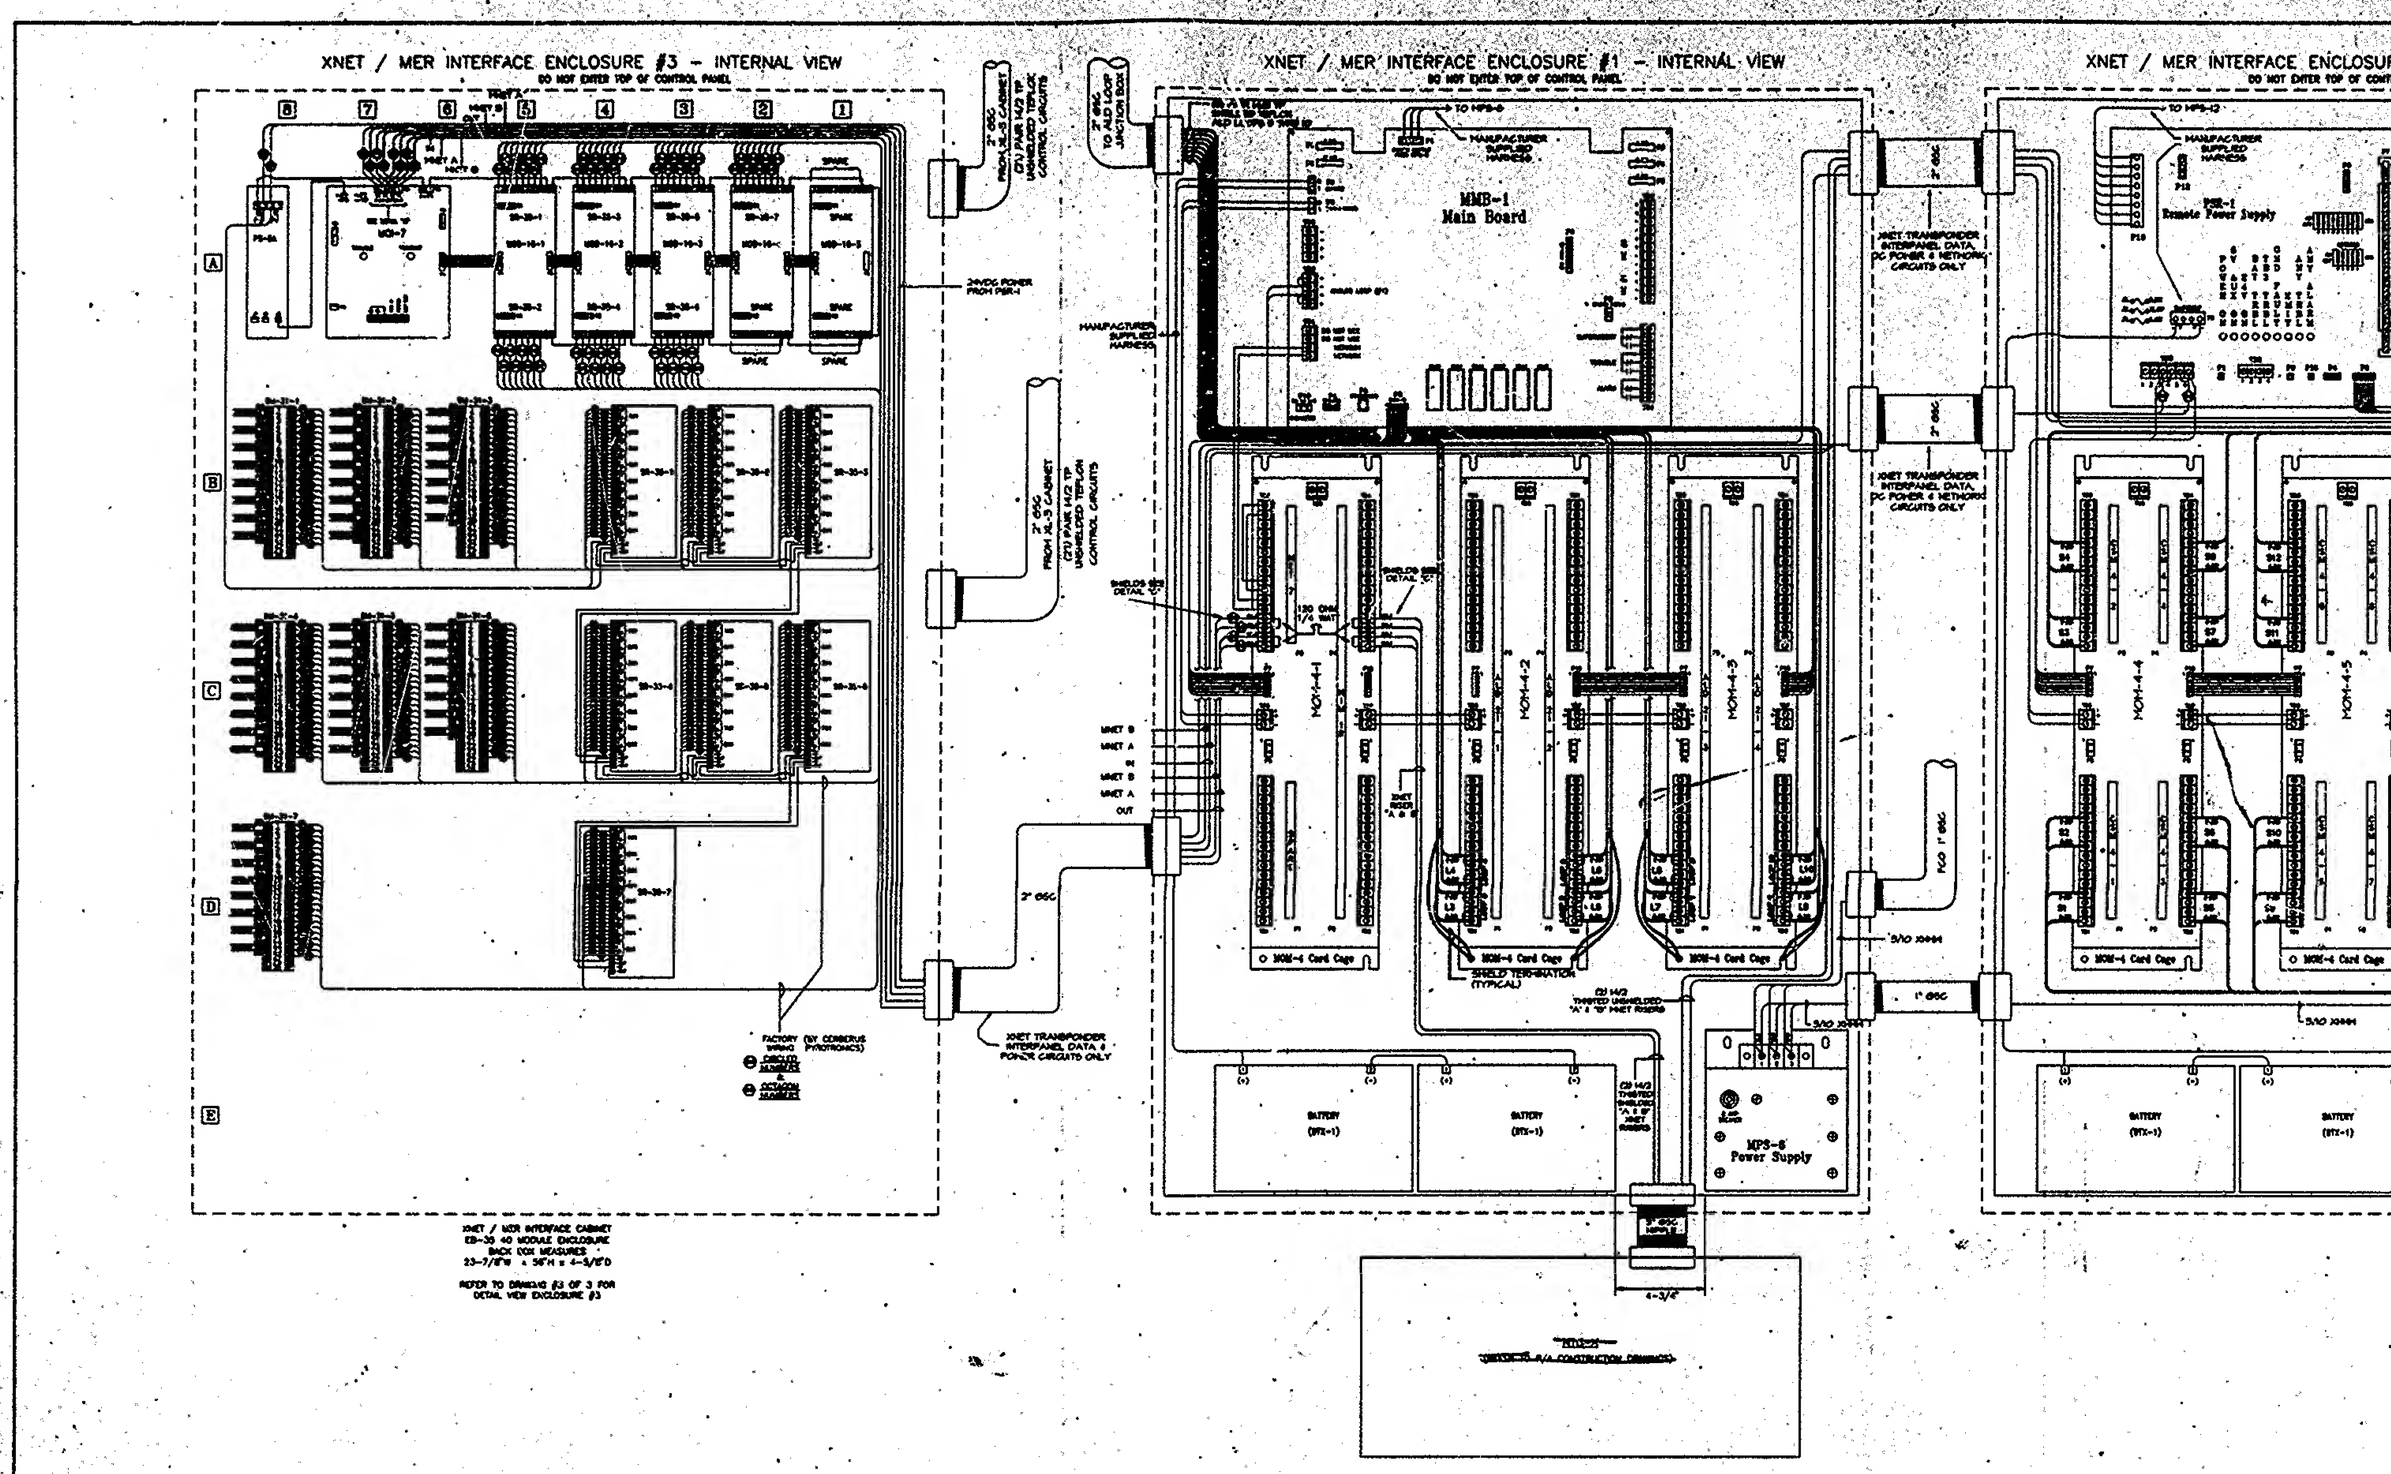
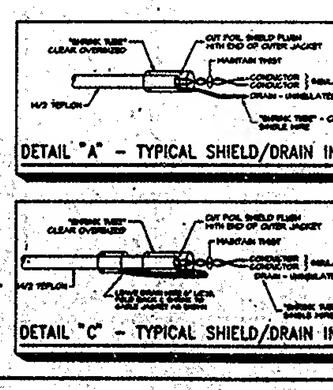
LEGEND		WIRING	NOTES
XNET-A	X-NETWORK "A" CIRCUITS	1. ALL AC POWER WIRING SHALL BE #10 AWG XHHW-2 (WHITE & BLACK).	1) SYSTEM SHALL BE INSTALLED IN ACCORDANCE WITH SIEMENS-CERBERUS DIVISION SPECIFICATIONS, APPLICABLE CODES & THE CONTRACT DOCUMENTS. DISCREPANCIES, CONFLICTS AND OMISSIONS FOUND ON ANY DOCUMENT, DRAWING, SECTION, ETC. SHALL BE REPORTED IMMEDIATELY TO THE SIEMENS-CERBERUS DIVISION PROJECT MANAGER. INSTALLING CONTRACTOR SHALL NOT PROCEED UNTIL CLARIFICATION AND RESOLUTION IS ISSUED IN WRITING BY SIEMENS-CERBERUS DIVISION PROJECT MANAGER. ALL WORK SHALL BE FULLY INSPECTED AND TESTED BY A CERTIFIED SYSTEMS TECHNICIAN DESIGNATED BY THE SIEMENS-CERBERUS DIVISION PROJECT MANAGER. SYSTEMS SHALL NOT BE POWERED UP PRIOR TO THIS POINT.
XNET-B	X-NETWORK "B" CIRCUITS	2. AMPLIFIER BATTERY WIRING SHALL BE #10 AWG XHHW-2 (RED & BLACK).	2) ALL CONNECTIONS MADE DIRECTLY OR INDIRECTLY TO SIEMENS-CERBERUS DIVISION EQUIPMENT AND SYSTEMS SHALL BE IN ACCORDANCE WITH ALL SIEMENS-CERBERUS DIVISION DRAWINGS, SKETCHES, BULLETINS AND SPECIFICATIONS. EQUIPMENT, METHODS OR MATERIALS NOT LISTED AND APPROVED FOR USE WITH THE EQUIPMENT BY SIEMENS-CERBERUS DIVISION SHALL NOT BE EMPLOYED.
MNET-A	M-NETWORK "A" CIRCUIT	3. HIGH LEVEL AUDIO, SPEAKER, CONTROL & SOLENOID CIRCUITS SHALL BE #14 AWG UNSHIELDED TEFLON.	3) CONTRACTOR SHALL PERFORM ALL WORK SHOWN OR SIEMENS-CERBERUS DIVISION DRAWINGS, WHICH INCLUDES INTERNAL WIRING REMOVAL, CHANGES & ADDITIONS AND EXTERNAL WIRING TERMINATIONS AS WELL AS COMPONENT INSTALLATION. ALL WORK SHALL BE PERFORMED IN THE PRESENCE OF THE ENGINEER.
MNET-B	M-NETWORK "B" CIRCUIT	4. LOW LEVEL AUDIO, NETWORK, ALD, STROBE, TELEPHONE CIRCUITS SHALL BE #14 AWG SHIELDED TEFLON.	
LL1	LOW LEVEL CHANNEL 1 RISER (PHASE/ALERT)	5. ALL WIRING DEVICES, TERMINALS, CONNECTORS, ETC SHALL BE UL LISTED / FMA APPROVED FOR THE TYPE WIRE USED.	
LL2	LOW LEVEL CHANNEL 2 RISER (EVAC)	6. ALL TERMINAL CONNECTORS FOR #10 AWG SHALL BE APPROVED FOR SOLID WIRE CONNECTION.	
LLT	LOW LEVEL TELEPHONE RISER (TEL)		
HL1	HIGH LEVEL CHANNEL 1		
HL2	HIGH LEVEL CHANNEL 2		
ALD	ANALOG LOOP DRIVER (L-4)		
CSM	CONVENTIONAL SIGNAL MODULE (S-4)		
	DARK SOLID LINES INDICATE WORK TO BE DONE.		
	LIGHT SOLID LINES INDICATE EXISTING TO REMAIN.		
	DARK CENTER LINES INDICATE EXISTING WIRING RELOCATED.